


Mass Spectrum

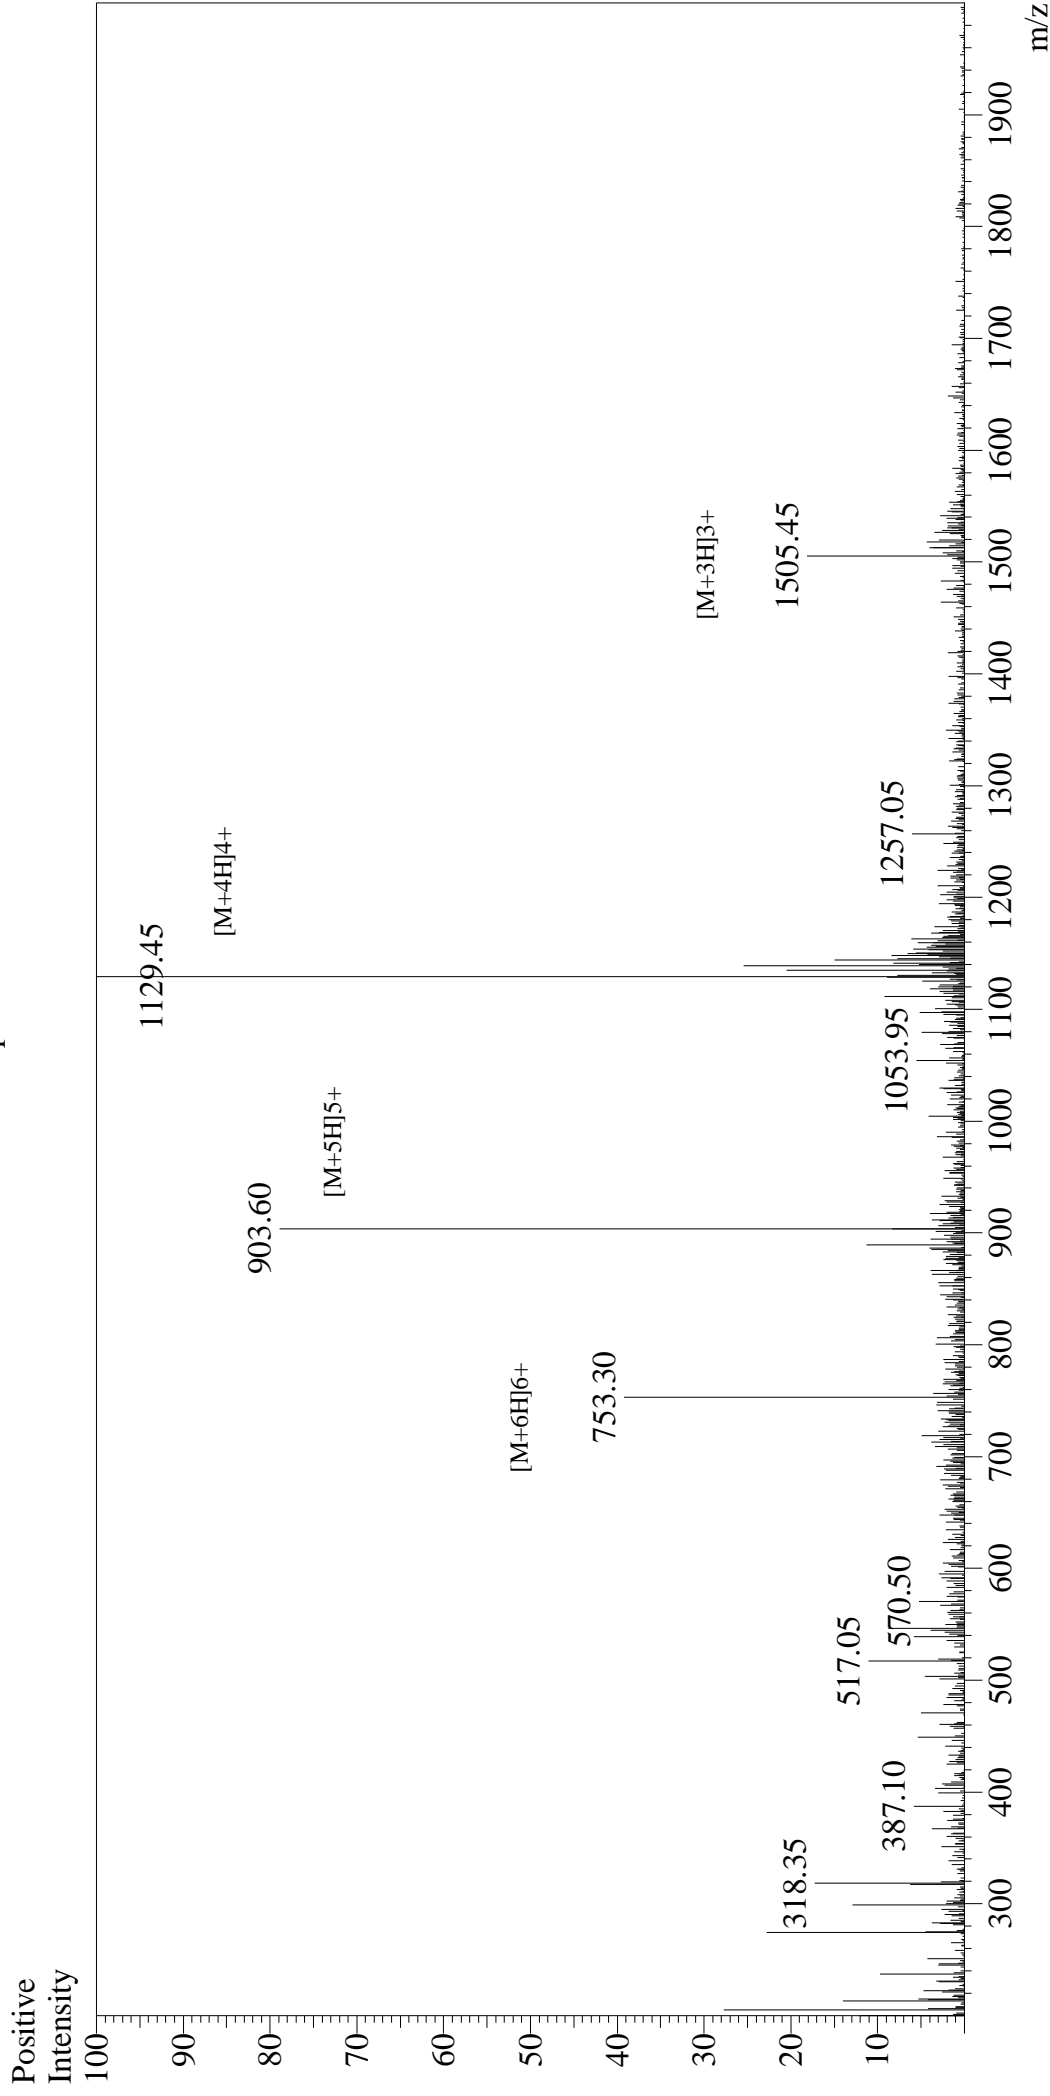

Sample Information

User : Gary
 Month-Day Processed : 03/29/16
 Time Processed : 10:04:14
 Injection Volume : 0.2
 Sample Name : β -Amyloid (1-42), human
 Cat No. : RPI0017
 Lot No. : PE8831603
 Theoretical MW : 4514.10
 Observed MW : 4513.80

Interface : ESI
 Nebulizing Gas Flow : 1.5L/min
 CDL Temp : 250°C
 Block Temp : 200°C

Interface Bias : +4.5kV
 Drying Gas Flow : 5 L/min
 T.Flow : 0.2ml/min
 B.conc : 50% H₂O/50% MeOH