


Mass Spectrum

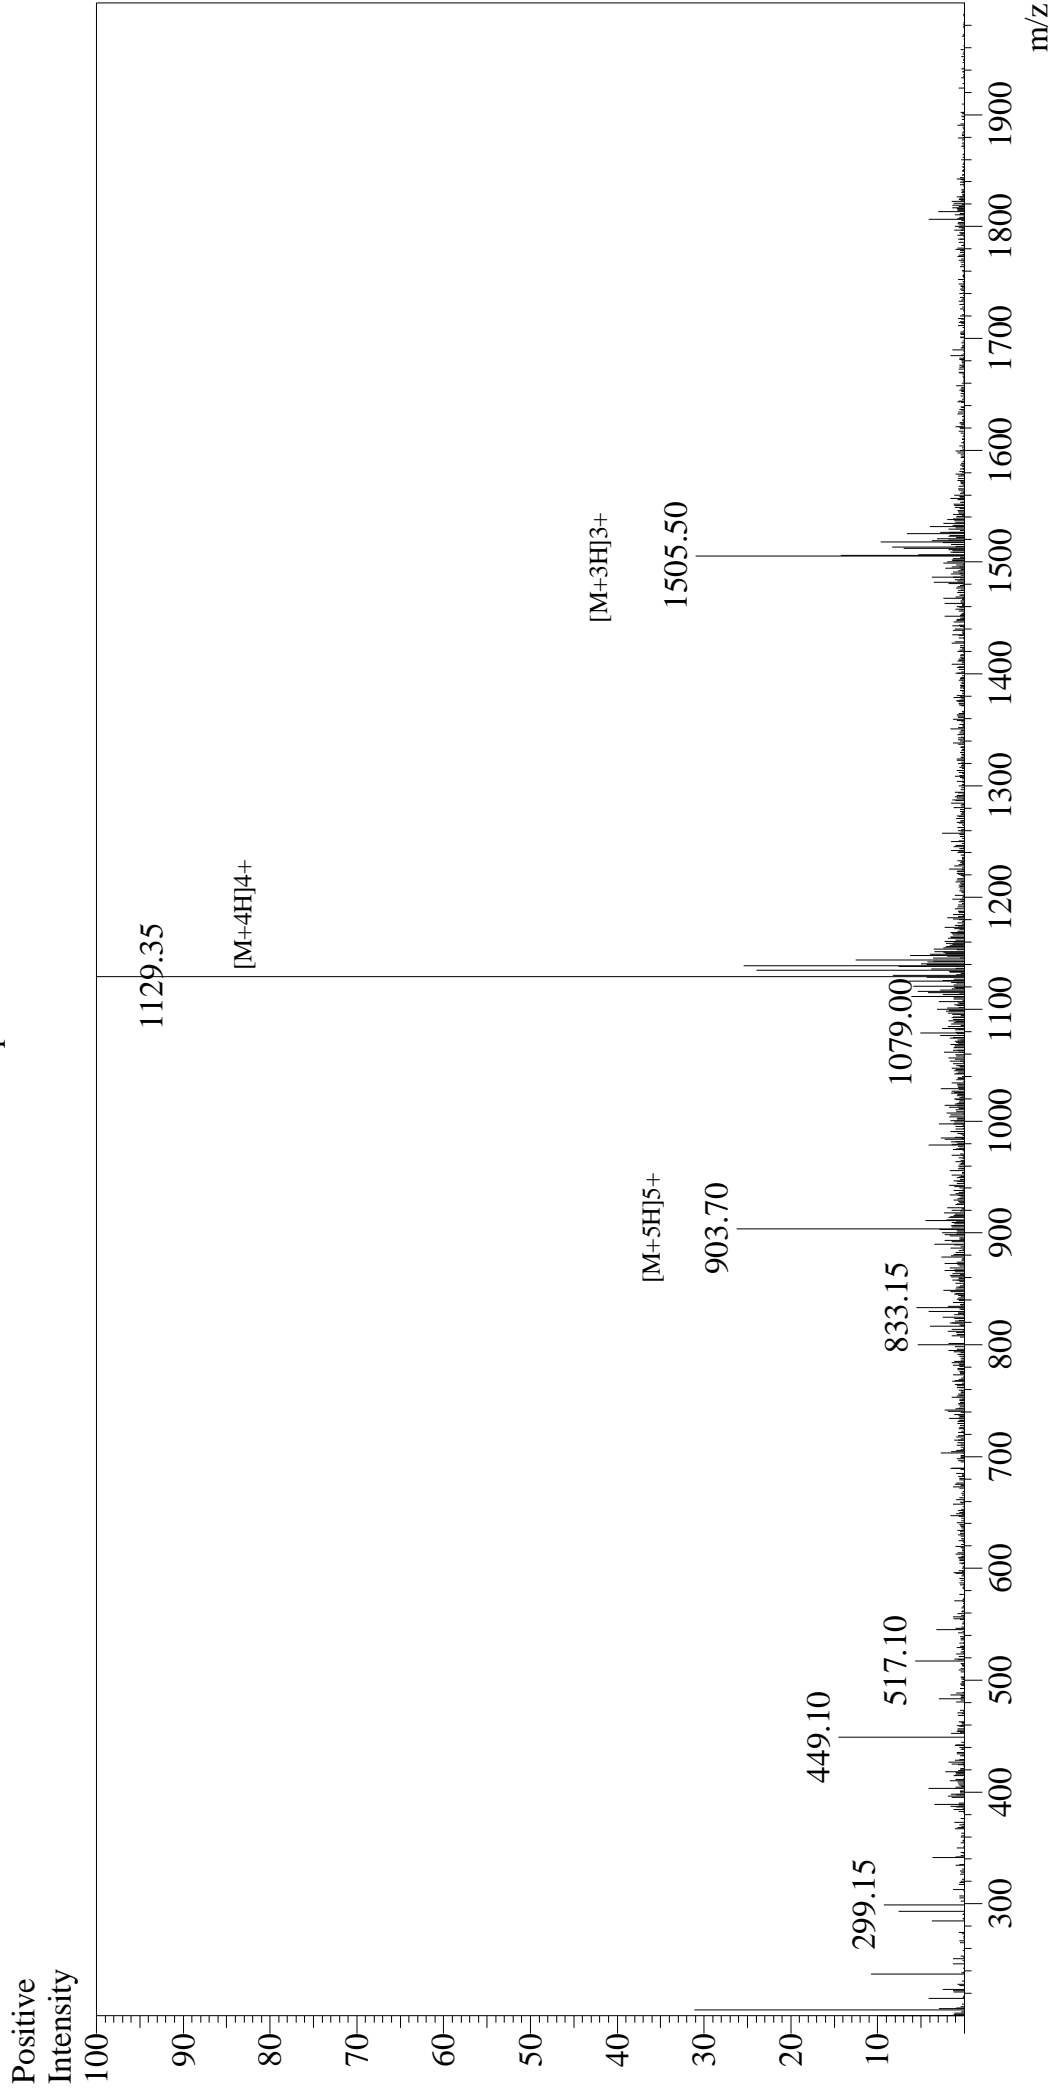

Sample Information

User : Gary
Month-Day Processed : 07/22/16
Time Processed : 15:08:14
Injection Volume : 0.5
Sample Name : β -Amyloid (1-42), human
Cat No. : RPI0017
Lot No. : PE9871607
Theoretical MW : 4514.10
Observed MW : 4513.40

Interface

Interface : ESI
Nebulizing Gas Flow : 1.5L/min
CDL Temp : 250°C
Block Temp : 200°C

Interface Bias

Interface Bias : +4.5kV
Drying Gas Flow : 5 L/min
T.Flow : 0.2ml/min
B.conc : 50%H₂O/50%MeOH