


Mass Spectrum

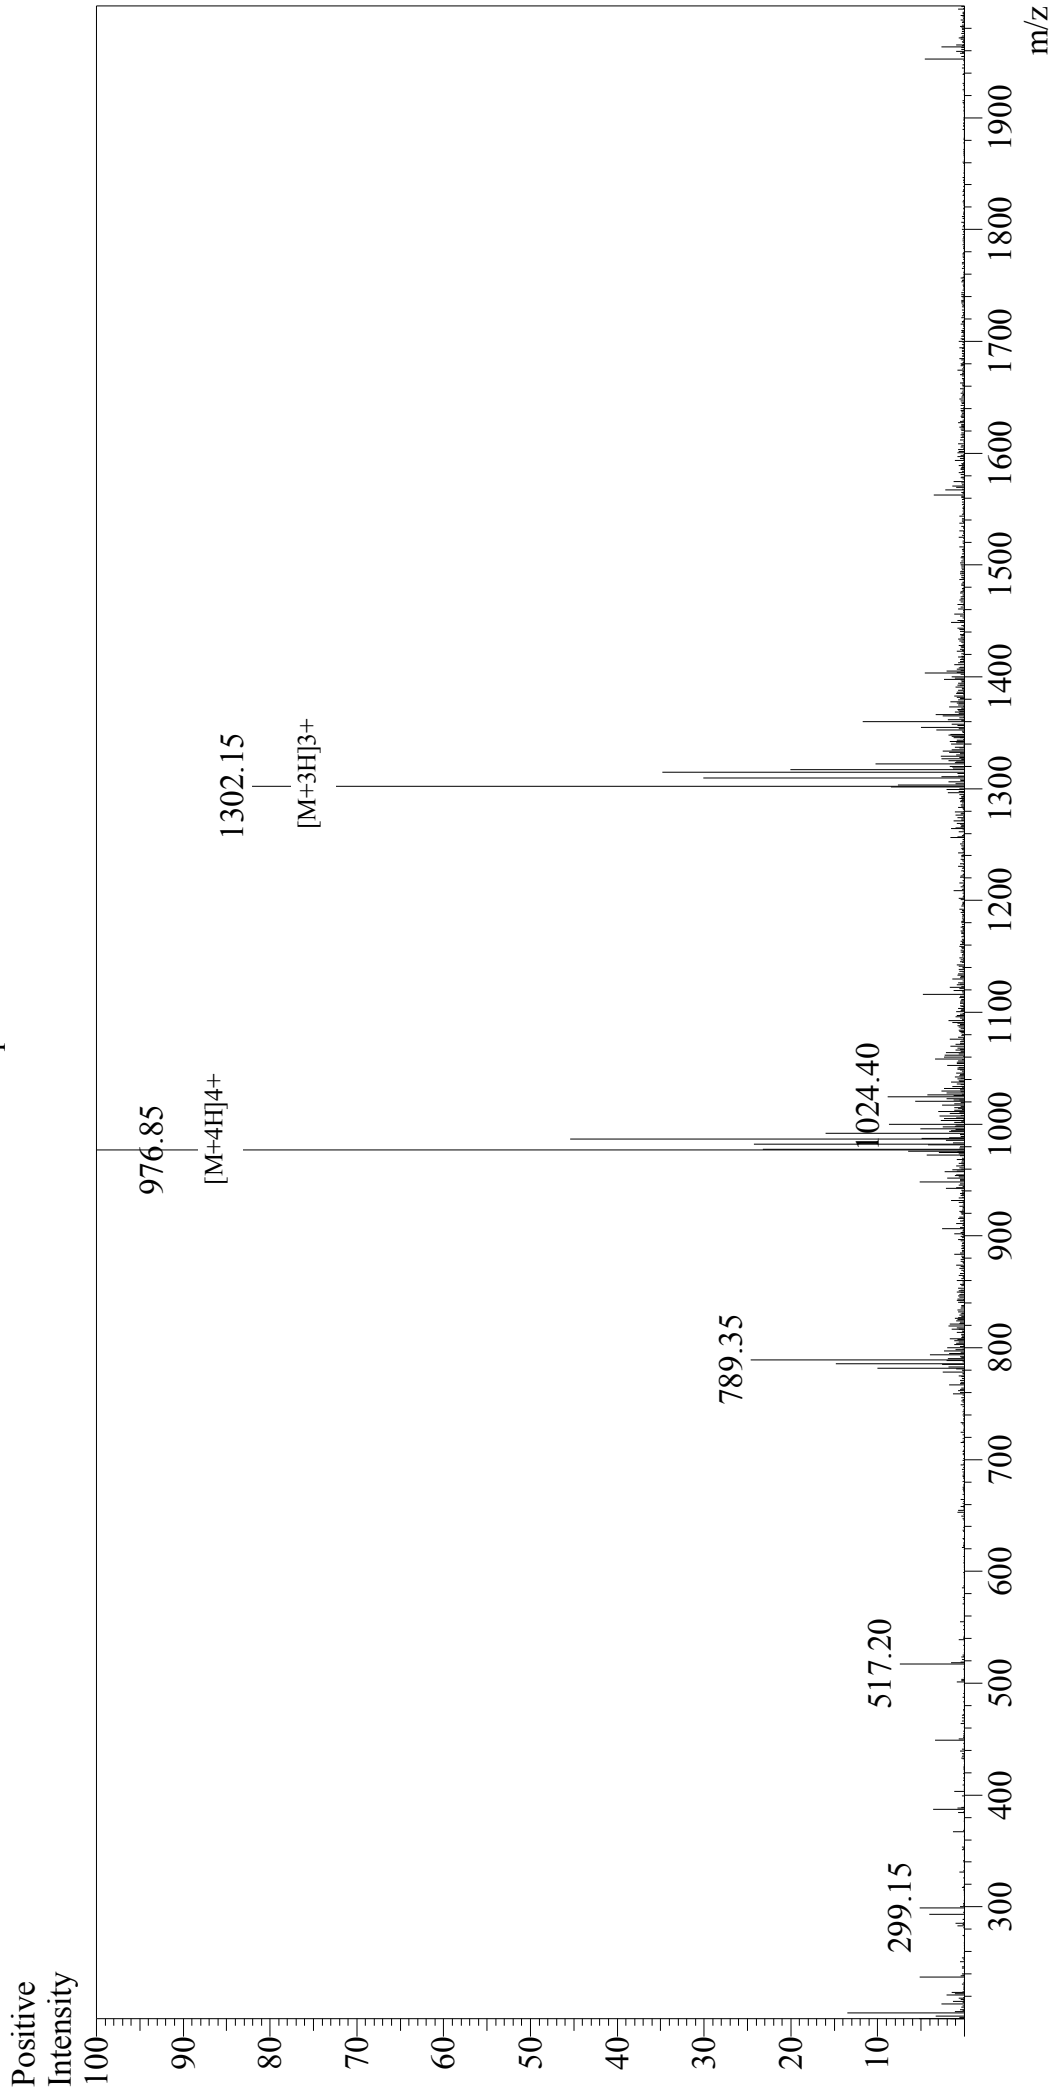

Sample Information

User : Gary
Month-Day Processed : 01/24/17
Time Processed : 11:04:51
Injection Volume : 1
Sample Name : Amylin, human, amide
Cat No. : RP11278
Lot No. : PE3341612
Theoretical MW : 3903.31
Observed MW : 3903.40

Interface

Interface : ESI
Nebulizing Gas Flow : 1.5L/min
CDL Temp : 250°C
Block Temp : 200°C

Interface Bias

Interface Bias : +4.5kV
Drying Gas Flow : 5 L/min
T.Flow : 0.2ml/min
B.conc : 50%H2O/50%MeOH