

Sample Name : c-Myc Peptide  
 Cat. No. :RP11731  
 Lot. No. :PE8851707

Pump A : 0.065% trifluoroacetic in 100% water (v/v)  
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)  
 Total Flow:1 ml/min  
 Wavelength:220 nm


Time	Unit	Command	Value	Comment
0.01	Pumps	Pump A B.Conc	5	
25.00	Pumps	Pump A B.Conc	65	
25.01	Pumps	Pump A B.Conc	95	
31.00	Pumps	Pump A B.Conc	95	
31.01	Pumps	Pump A B.Conc	5	
40.00	Pumps	Pump A B.Conc	5	
40.01	Controller	Stop		

<<Column Performance>>

<Detector A>

Column : Inertsil ODS-3 4.6 x 250 mm

Chromatogram

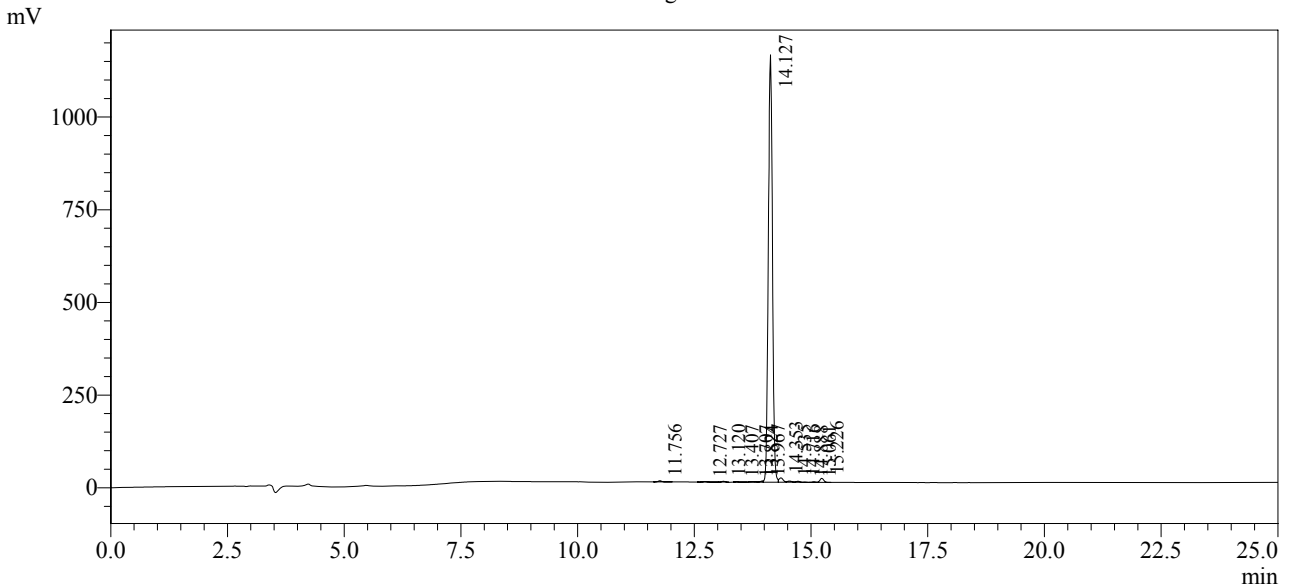

1 Det.A Ch1 / 220nm

Peak Table

Detector A Ch1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	11.756	17801	3165	0.242
2	12.727	10045	1350	0.137
3	13.120	11100	2256	0.151
4	13.407	4499	856	0.061
5	13.707	5334	897	0.073
6	13.824	4361	888	0.059
7	13.967	13310	3310	0.181
8	14.127	7102501	1152791	96.622
9	14.353	70118	11773	0.954
10	14.535	22911	3260	0.312
11	14.716	16492	2719	0.224
12	14.888	1427	323	0.019
13	15.061	8496	1571	0.116
14	15.226	62427	10949	0.849
Total		7350823	1196107	100.000