

Sample Name :Glucagon-Like Peptide (GLP) I (7-36), amide, human  
 Cat No :RP10773  
 Lot No :E6882321F  
 Time Processed :8:50:23  
 Month-Day-Year Processed :06/09/2021


Pump A : 0.065% trifluoroacetic in 100% water (v/v)  
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)  
 Total Flow:1 ml/min  
 Wavelength:220 nm

Time	Module	Command	Value
0.10	Pumps	Pump A B.Conc	5
25.00	Pumps	Pump A B.Conc	65
25.01	Pumps	Pump A B.Conc	95
27.00	Pumps	Pump A B.Conc	95
27.01	Pumps	Pump A B.Conc	5
35.00	Pumps	Pump A B.Conc	5
35.01	Controller	Stop	

<<Column Performance>>

<Detector A>

Column : Inertsil ODS-3 4.6 x 250 mm

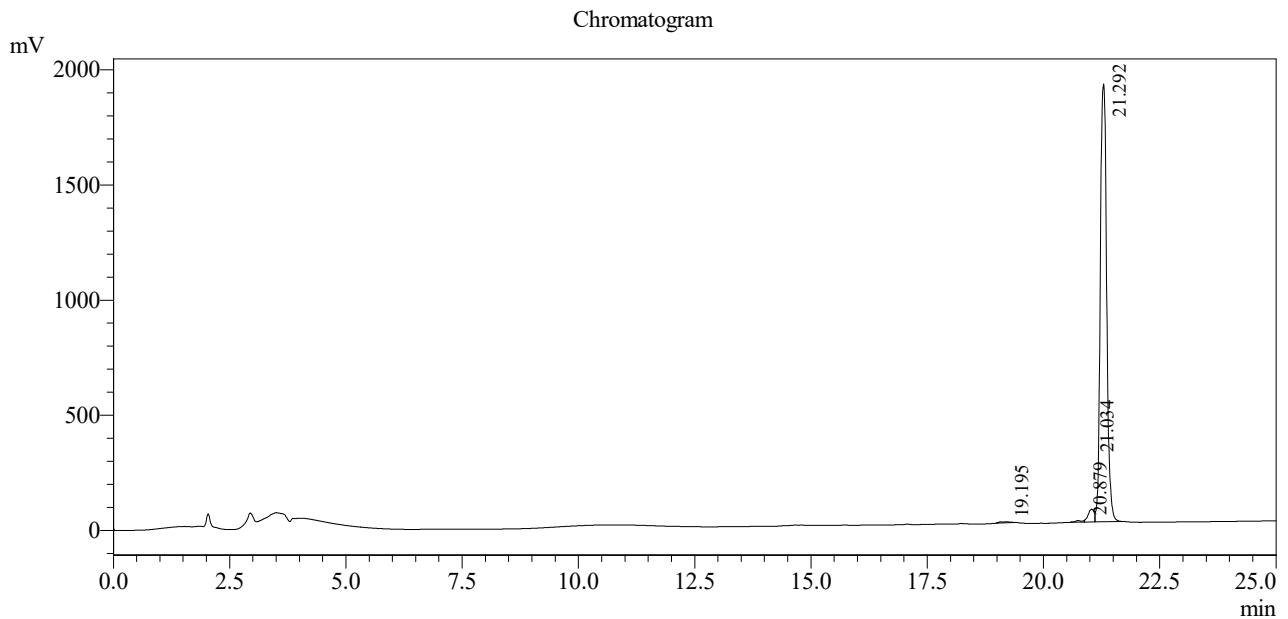

Peak Table

Detector A Channel 1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	19.195	63576	4385	0.340
2	20.879	72555	6983	0.388
3	21.034	509112	55355	2.725
4	21.292	18040204	1900949	96.547
Total		18685447	1967672	100.000