

Sample Name :Gastric Inhibitory Peptide (GIP), human
 Cat No :RP10795
 Lot No :E4079821G
 Time Processed :22:59:59
 Month-Day-Year Processed :07/28/2021


Pump A : 0.065% trifluoroacetic in 100% water (v/v)
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)
 Total Flow:1 ml/min
 Wavelength:220 nm

Time	Module	Command	Value
0.01	Pumps	Pump A B.Conc	5
25.00	Pumps	Pump A B.Conc	65
25.01	Pumps	Pump A B.Conc	95
31.00	Pumps	Pump A B.Conc	95
31.01	Pumps	Pump A B.Conc	5
40.00	Pumps	Pump A B.Conc	5
40.01	Controller	Stop	

<<Column Performance>>

<Detector A>

Column : Inertsil ODS-3 4.6 x 250 mm

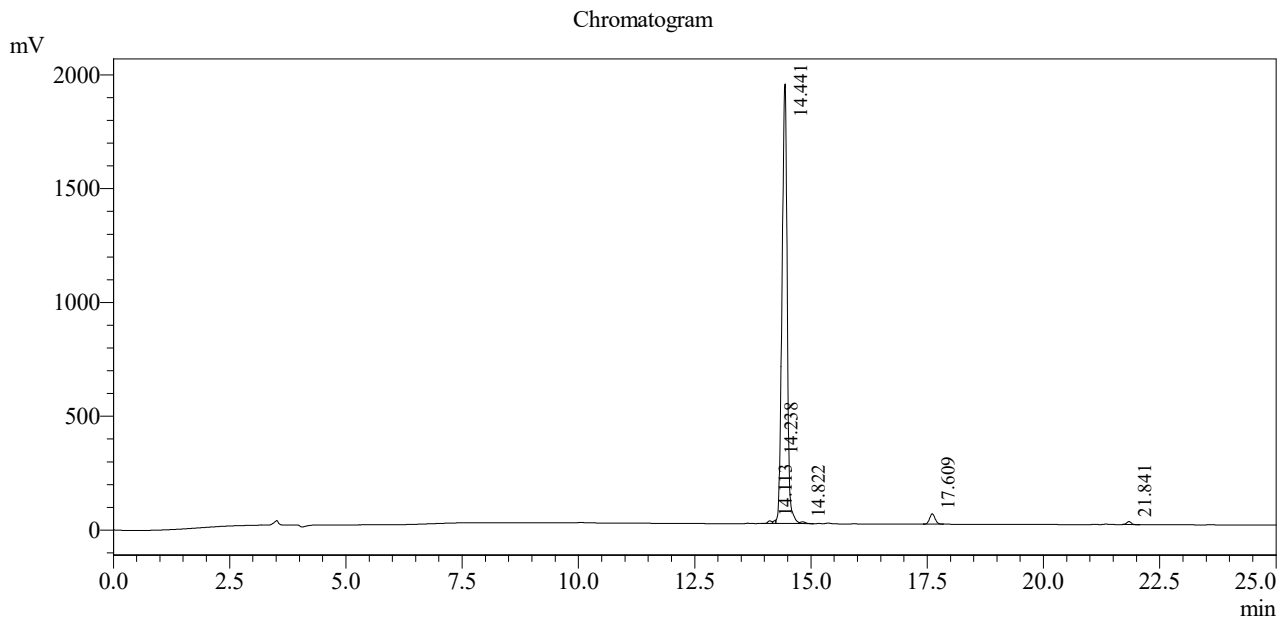

1 Detector A Channel 1 / 220nm

Peak Table

Detector A Channel 1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	14.113	60244	11326	0.386
2	14.238	43930	13748	0.281
3	14.441	15002901	1931271	96.020
4	14.822	55621	7581	0.356
5	17.609	369259	45212	2.363
6	21.841	92846	13685	0.594
Total		15624801	2022824	100.000