


Mass Spectrum

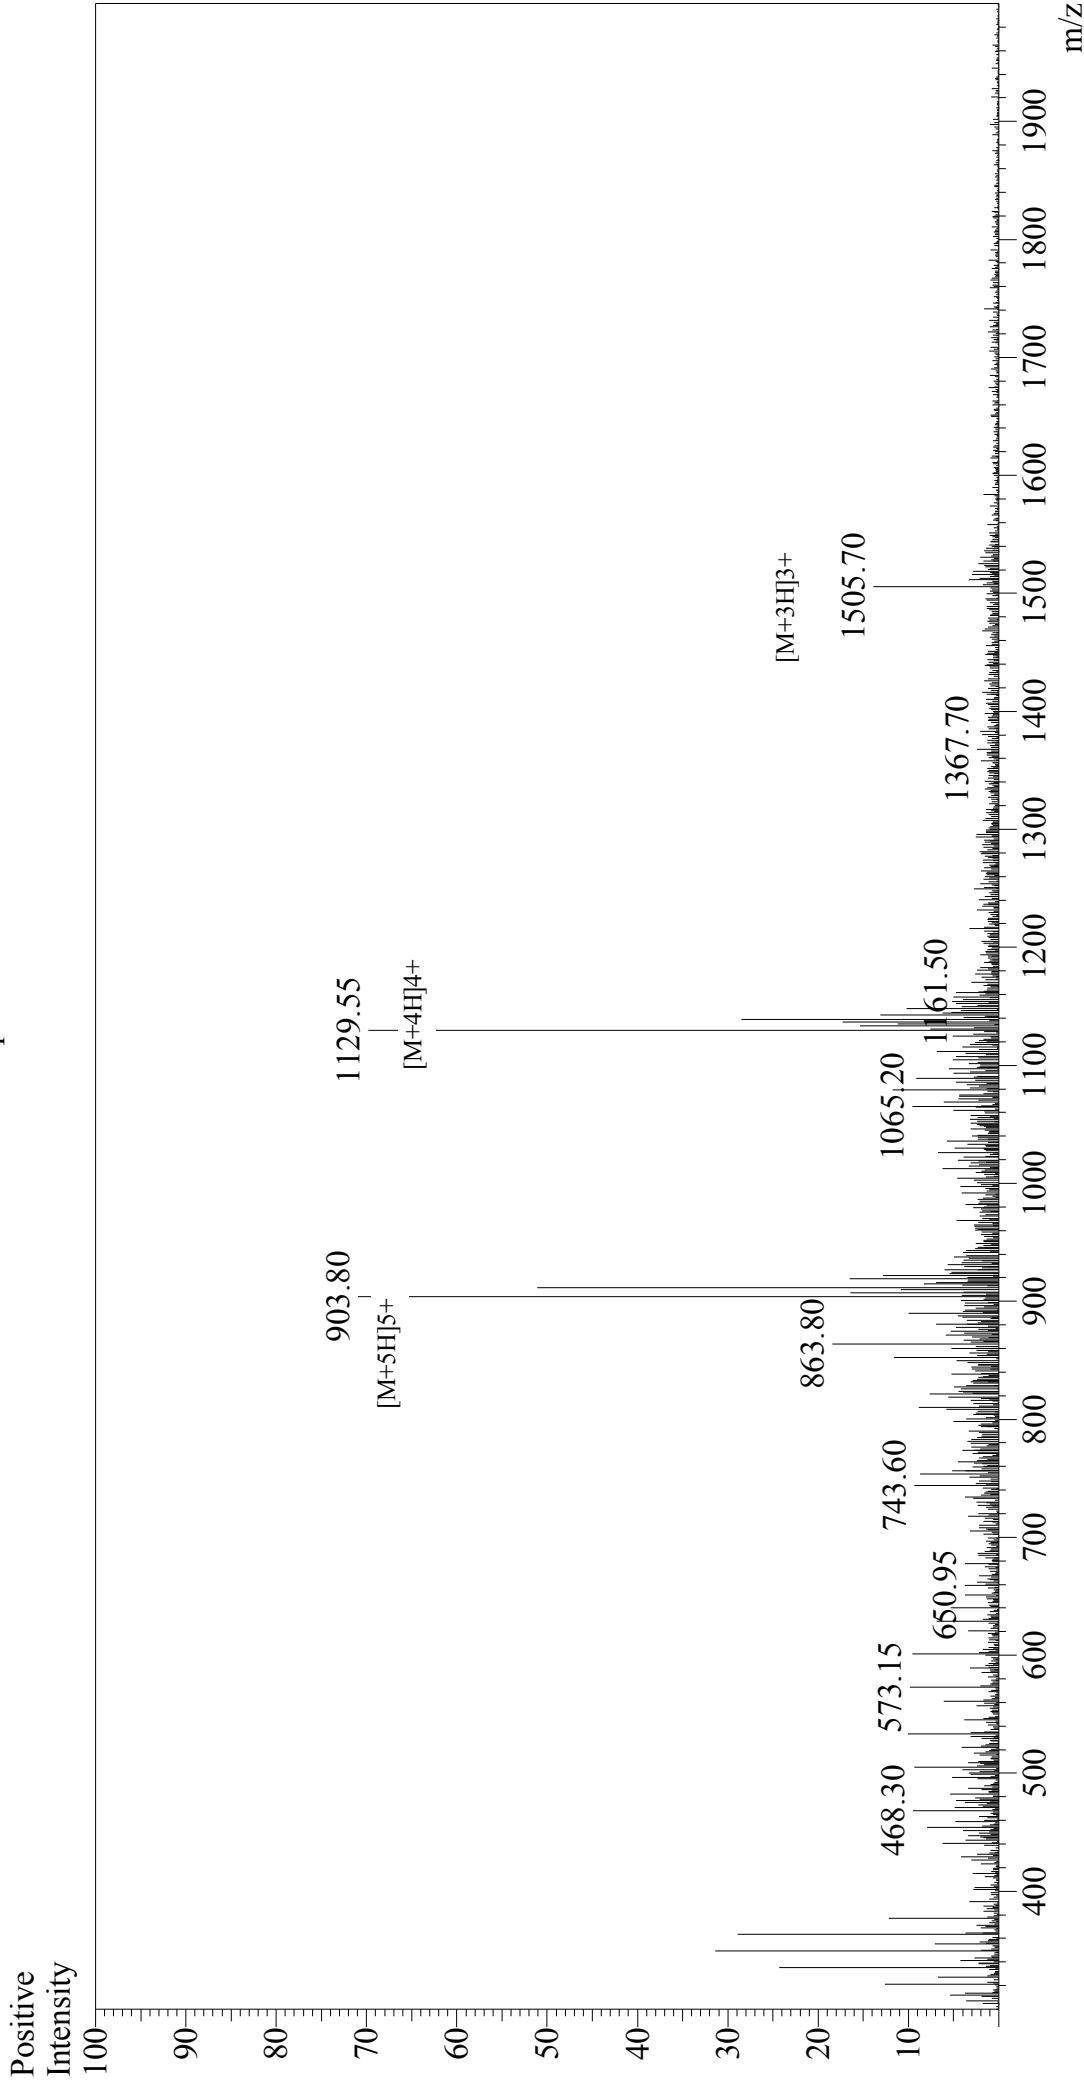

Sample Information

Acquired by : Gary
 Month-Day Processed : 09/19/17
 Time Processed : 15:37:44
 Injection Volume : 0.2
 Sample Name : β -Amyloid (1-42), human
 Cat No. : RP10017
 Lot No. : PE6161709
 Theoretical MW : 4514.10
 Observed MW : 4514.00

Interface

Interface : ESI
 Nebulizing Gas Flow : 1.5L/min
 CDL Temp : 250°C
 Block Temp : 200°C

Interface Bias

Interface Bias : +4.5 kV
 Drying Gas Flow : 5 L/min
 T.Flow : 0.2 ml/min
 B.conc : 50%H2O/50%MeOH