

Sample Name : c-Myc Peptide
 Cat. No. : RP11731
 Lot. No. : PE1621812
 Time Processed : 13:46:46
 Month-Day-Year Processed : 12/13/2018

Pump A : 0.065% trifluoroacetic in 100% water (v/v)
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)
 Total Flow:1 ml/min
 Wavelength:220 nm

Time	Unit	Command	Value	Comment
0.01	Pumps	Pump B Conc.	5	
25.00	Pumps	Pump B Conc.	65	
25.01	Pumps	Pump B Conc.	95	
27.00	Pumps	Pump B Conc.	95	
27.01	Pumps	Pump B Conc.	5	
35.00	Pumps	Pump B Conc.	5	
35.01	Controller	Stop		


<<Column Performance>>

<Detector A>

Column :Inertsil ODS-3 4.6 x 250 mm

Equipment: SS-CM-0309

Chromatogram

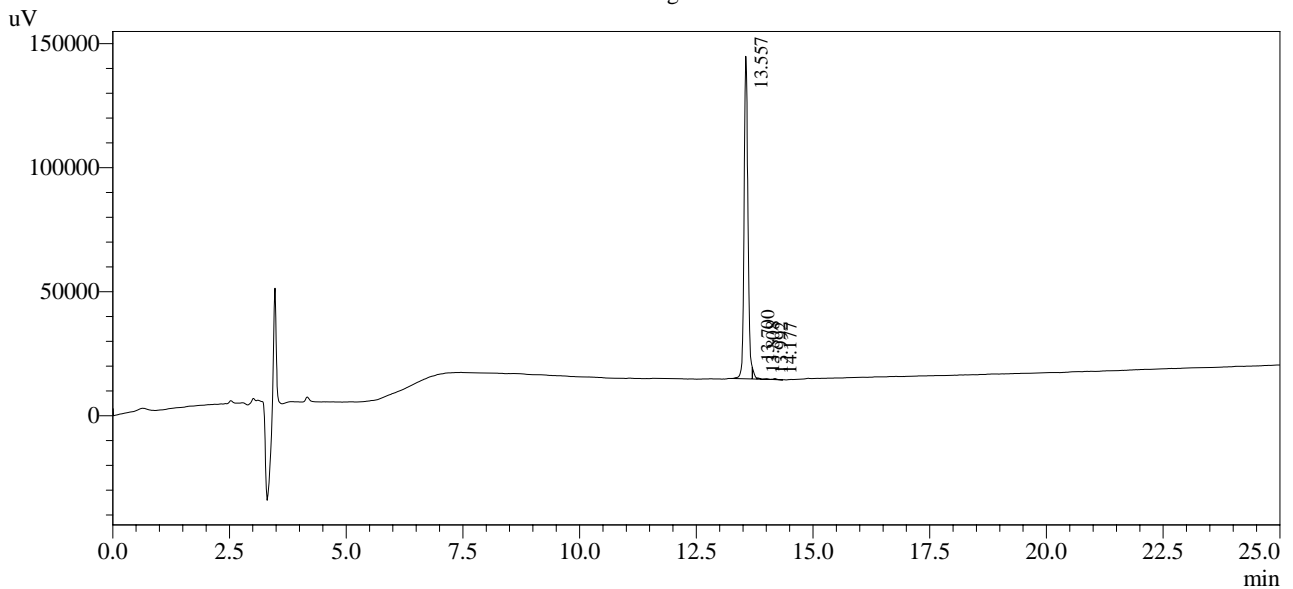

1 Det.A Ch1 / 220nm

Peak Table

Detector A Ch1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	13.557	747097	130063	97.935
2	13.700	10831	4721	1.420
3	13.808	1682	455	0.220
4	13.992	1259	222	0.165
5	14.177	1983	417	0.260
Total		762851	135878	100.000