

Sample Name :c-Myc Peptide  
 Cat. No. : RP11731  
 Lot. No. :PE5471812  
 Time Processed :9:43:05  
 Month-Day-Year Processed :12/20/2018

Pump A : 0.065% trifluoroacetic in 100% water (v/v)  
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)  
 Total Flow:1 ml/min  
 Wavelength:220 nm

Time	Unit	Command	Value	Comment
0.01	Pumps	Pump B Conc.	5	
25.00	Pumps	Pump B Conc.	65	
25.01	Pumps	Pump B Conc.	95	
27.00	Pumps	Pump B Conc.	95	
27.01	Pumps	Pump B Conc.	5	
35.00	Pumps	Pump B Conc.	5	
35.01	Controller	Stop		


<<Column Performance>>

<Detector A>

Column : Inertsil ODS-3 4.6 x 250 mm

Equipment :SS-CM-0310

Chromatogram

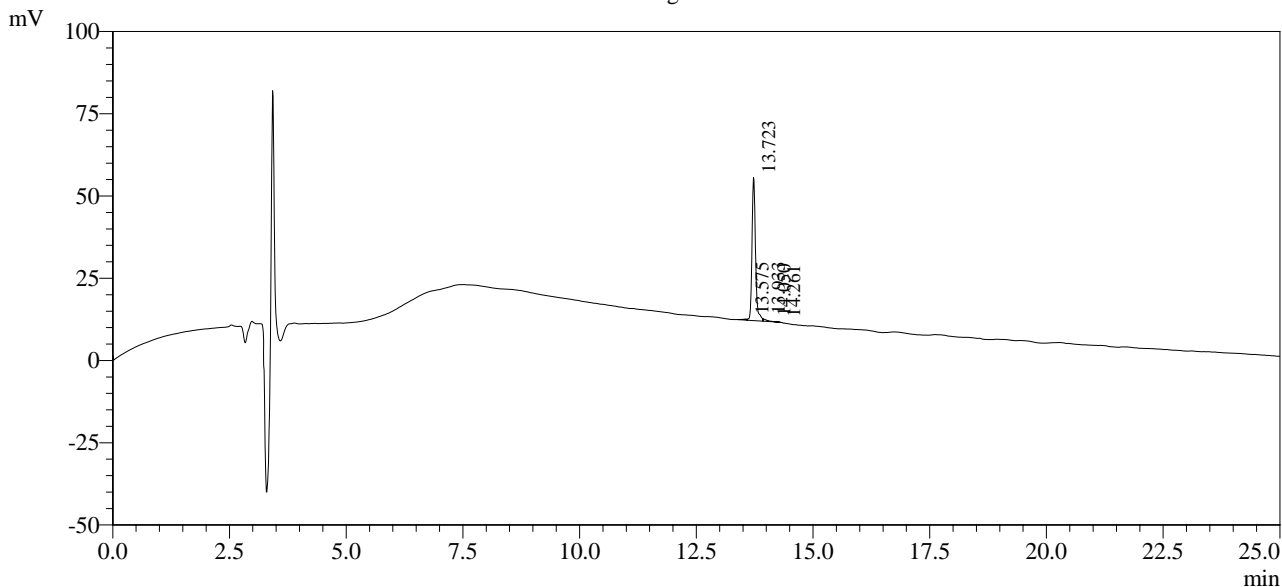

1 Det.A Ch1 / 220nm

Peak Table

Detector A Ch1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	13.575	1997	320	0.849
2	13.723	228539	43480	97.147
3	13.933	3272	705	1.391
4	14.050	1053	192	0.448
5	14.261	389	120	0.165
Total		235250	44817	100.000