


Mass Spectrum

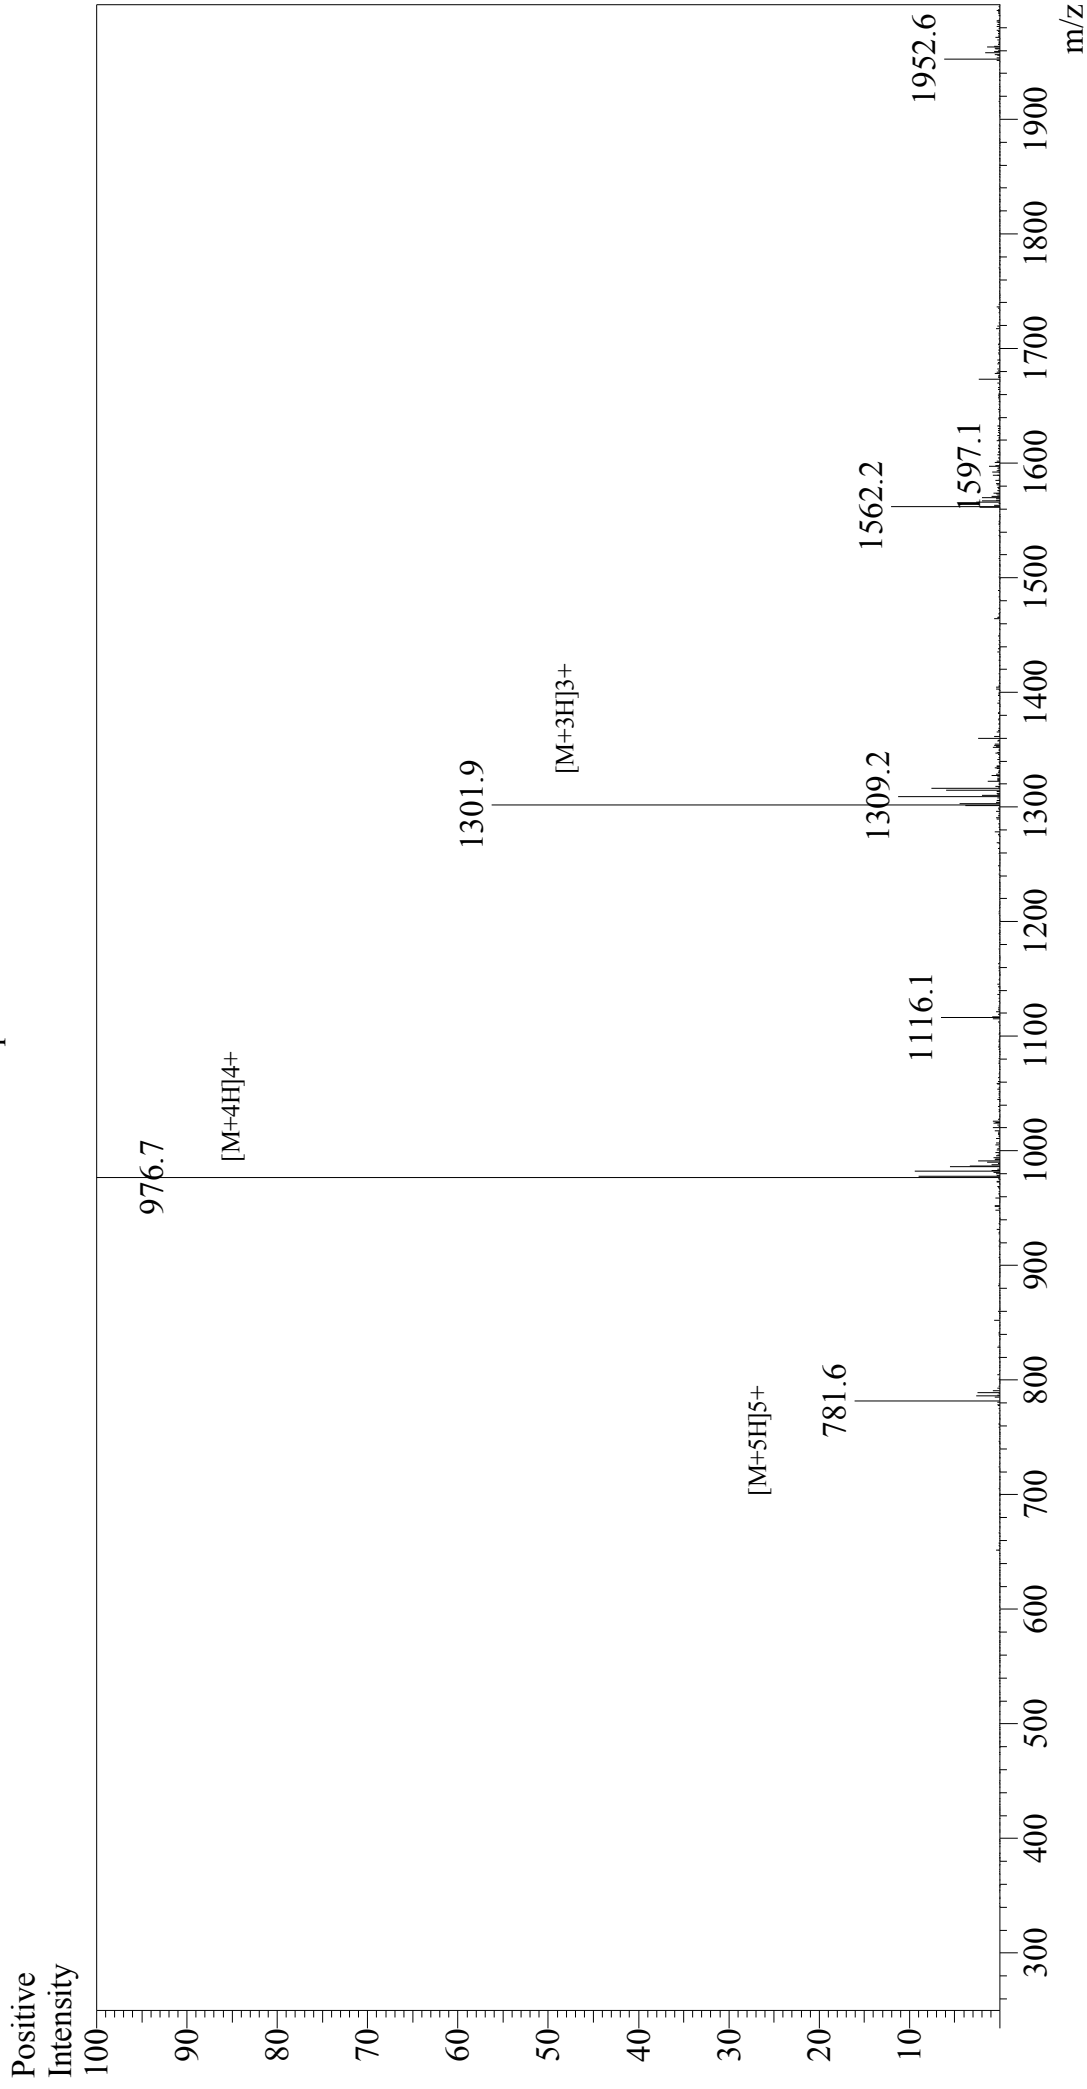

Sample Information

Acquired by : Gary
Month-Day Processed : 09/05/18
Time Processed : 15:30:59
Injection Volume : 0.2
Sample Name : Amylin, human, amide
Cat. No. : RP11278
Lot. No. : PE8751808
Theoretical MW : 3903.28
Observed MW : 3902.8

Interface : ESI
Nebulizing Gas Flow : 1.5L/min
CDL Temp : 250°C
Block Temp : 200°C

Interface Bias : +4.5 kV
Drying Gas Flow : 5 L/min
T.Flow : 0.2 ml/min
B.conc : 50% H_2O /50% $MeOH$